



Republic of the Philippines
CIVIL AVIATION AUTHORITY OF THE PHILIPPINES

BID BULLETIN NO. 01

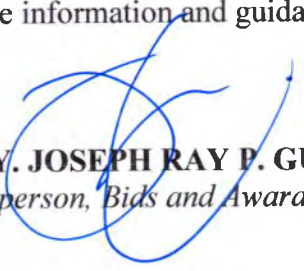
November 19, 2019

I. Attention is hereby invited to the Bidders of **Rehabilitation of Air-Conditioning System at Iloilo International Airport – Bid No. 19-054-10 Bravo.**

II. Please be informed of the following issues/clarifications:

Issues/Queries	Clarification/s
1. What is the Total Dynamic Head (TDH) and capacity of the Two (2) units Chilled Water Pump?	1. The Chilled Water Pump's total head and capacity are 20 m. and 1.72 m³/min respectively. Refer to Mechanical Plan M-2.
2. Can we extend the delivery date from 160 days to 210 days since the Ex-Factory ship date will be between 4 to 5 months?	2. No. The project completion is changed from one hundred sixty (160) calendar days to ONE HUNDRED EIGHTY (180) CALENDAR DAYS instead.
3. With reference to the Air Cooled Water Chiller Screw Type, the required refrigerant is R407C, can we use Chillers with R134A since Screw Chillers use the R134A refrigerant and R407C are usually used in Scroll compressors?	3. Yes. As stated in the Terms of Reference, Technical Specifications 4. <i>"The chillers shall operate using R-407C refrigerant or any refrigerant not subject to phase out by the Montreal Protocol or the U.S. Clean Air Act."</i>

For the information and guidance of all concerned.


ATTY. JOSEPH RAY P. GUMABON
Chairperson, Bids and Awards Committee - Bravo